

ADDENDUM NO. 1

Date June 30, 2026

City of Austin

Project Name: Hornsby Bend Biosolids Management Plant Headworks Improvements

C.I.P. No. 3164.075 IFB No.: 6100 CLMC1170

This Addendum forms a part of the Contract and corrects or modifies original Bid Documents, issued on June 15, 2026. **Acknowledge receipt of this addendum in space provided on bid form.** Failure to do so may subject bidder to disqualification.

A. Project Manual Revisions:

- 1) **Section 11314, Subsection 1.05.D.1.a.:** Delete "Flowserve" and replace with "Liberty Pumps"

B. Drawing Revisions:

- 1) **Drawing G-2A:** Replace sheet in its entirety.
- 2) **Drawing M-2A:** Add sheet in its entirety.
- 3) **Drawing M-2B:** Add sheet in its entirety.
- 4) **Drawing M-2C:** Add sheet in its entirety.


This addendum consists of 5 page(s)/sheet(s).

Approved by OWNER


Katelyn R. Backhaus

Approved by ENGINEER/ARCHITECT

END



6/30/2026

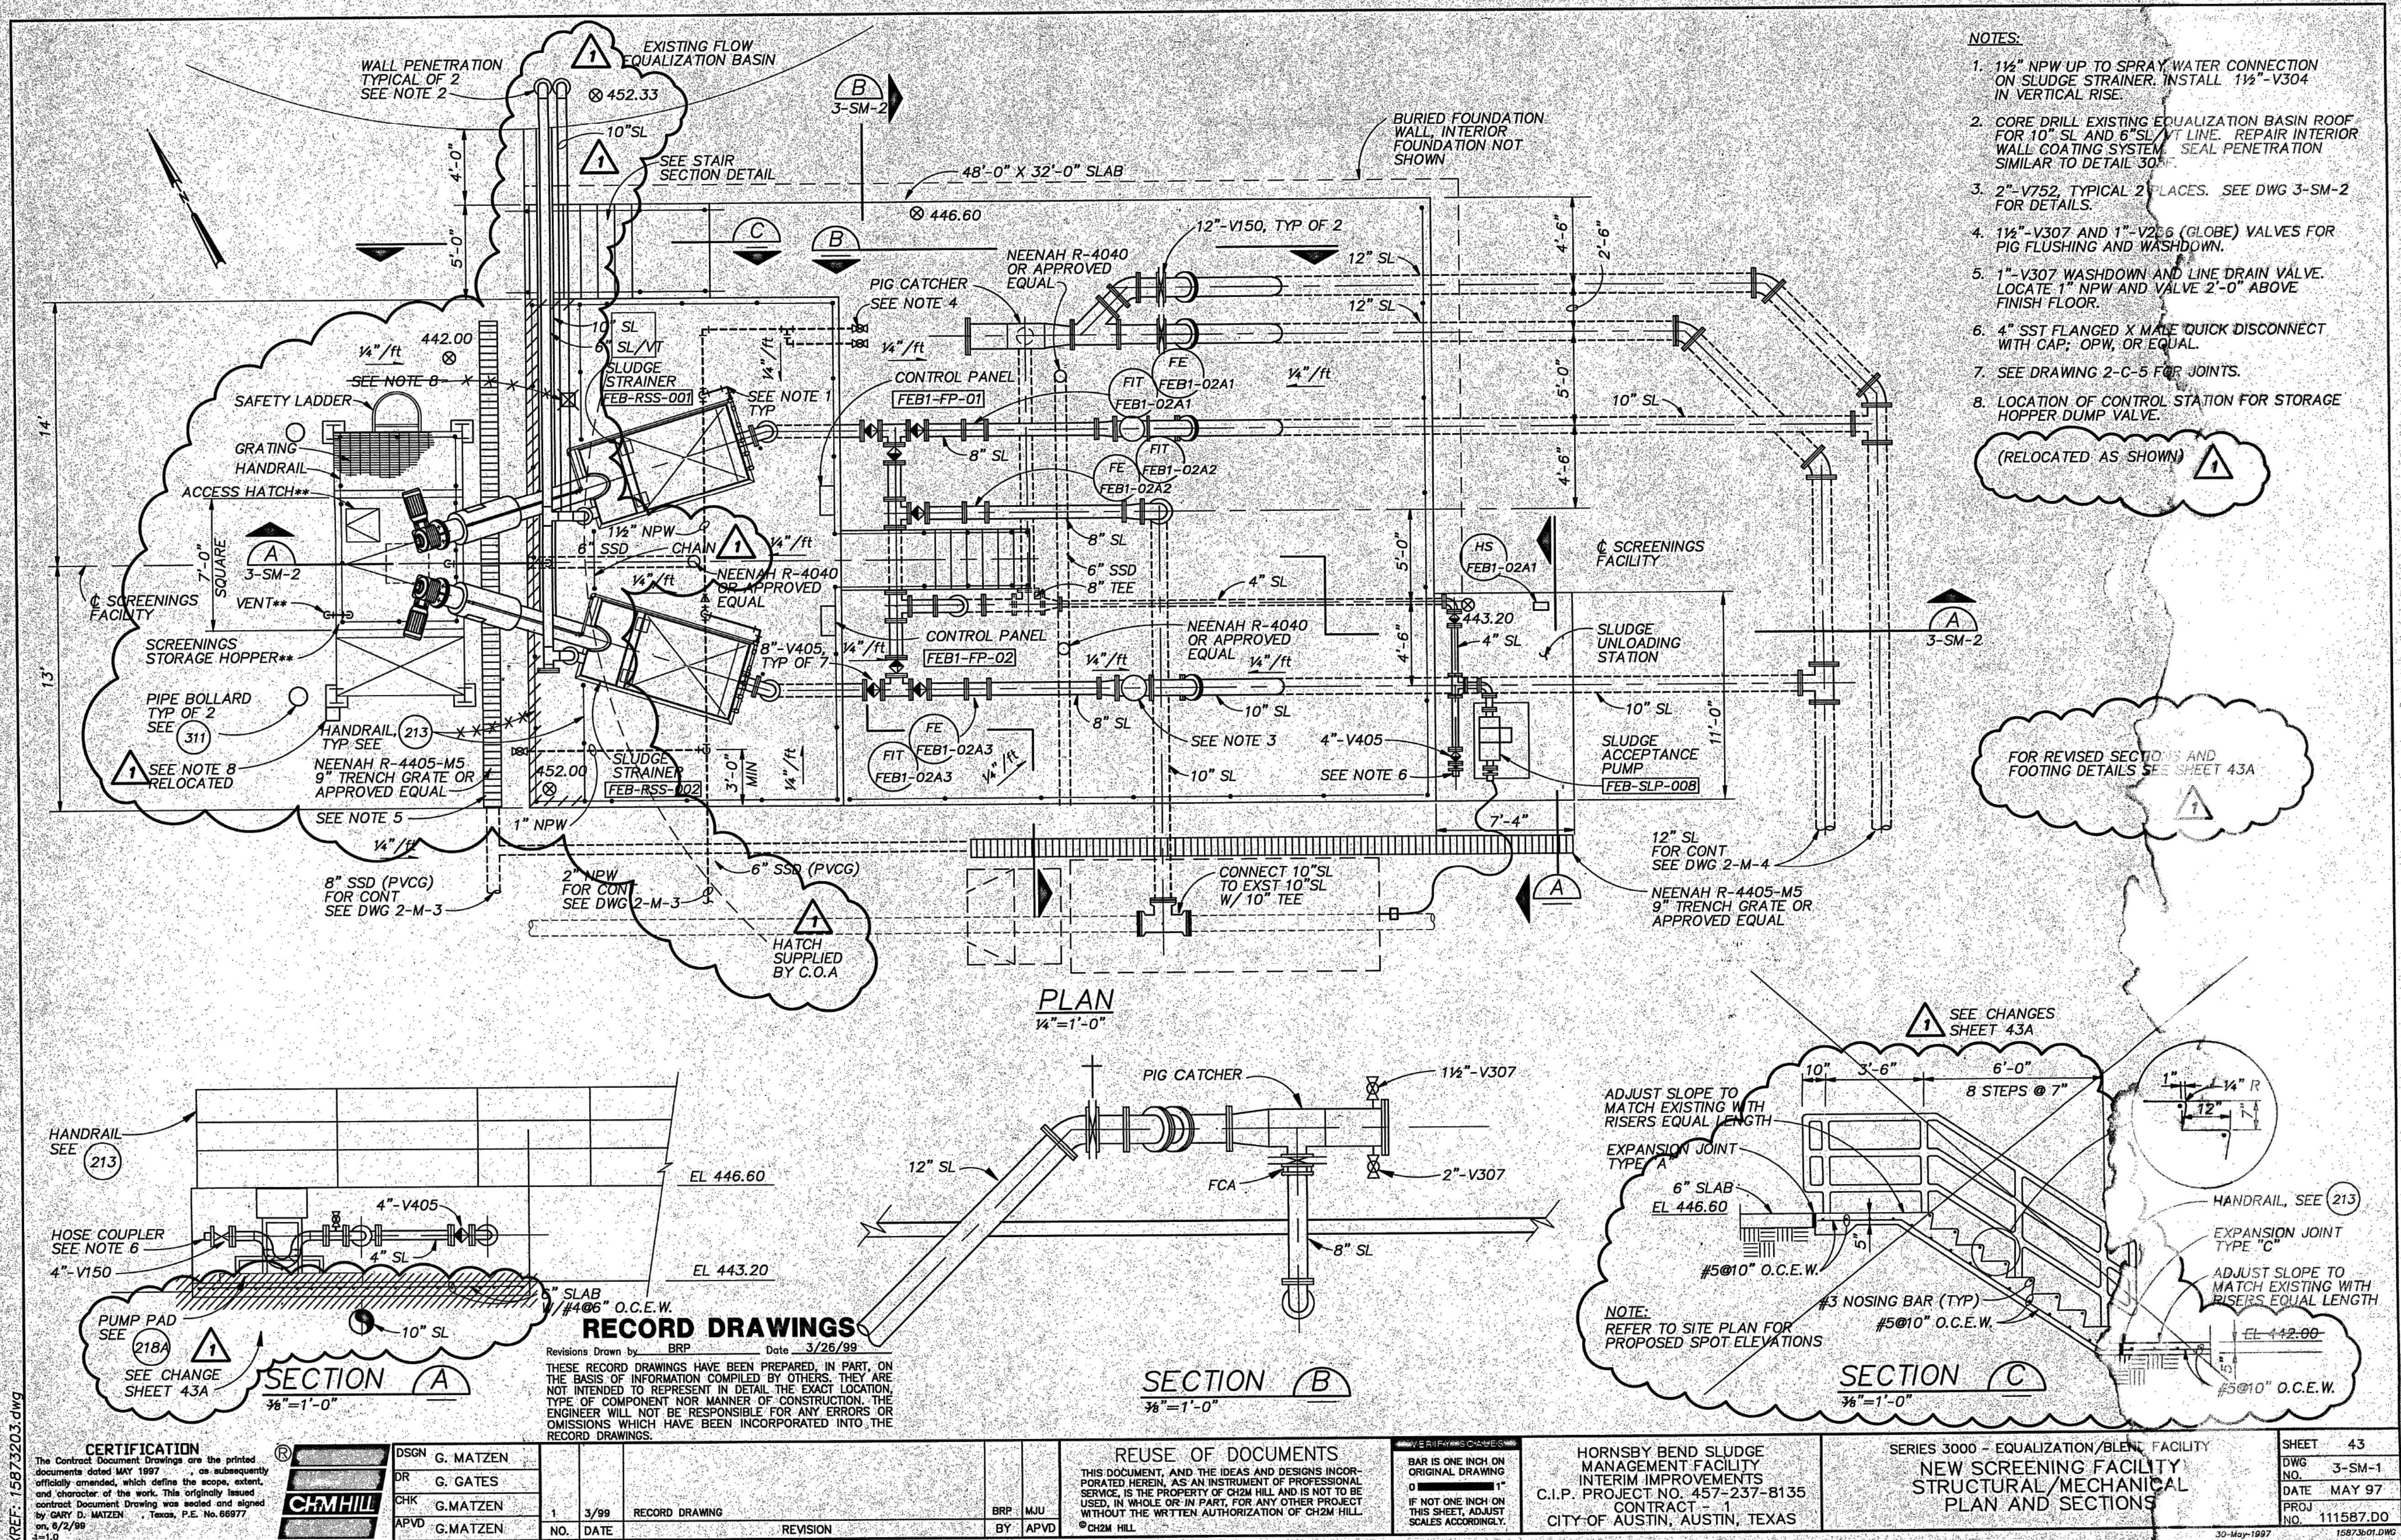

- NOTES:**
1. 1 1/2" NPW UP TO SPRAY WATER CONNECTION ON SLUDGE STRAINER. INSTALL 1 1/2" V304 IN VERTICAL RISE.
 2. CORE DRILL EXISTING EQUALIZATION BASIN ROOF FOR 10" SL AND 6" SL V/T LINE. REPAIR INTERIOR WALL COATING SYSTEM. SEAL PENETRATION SIMILAR TO DETAIL 301.
 3. 2" V752, TYPICAL 2 PLACES. SEE DWG 3-SM-2 FOR DETAILS.
 4. 1 1/2" V307 AND 1" V206 (GLOBE) VALVES FOR PIG FLUSHING AND WASHDOWN.
 5. 1" V307 WASHDOWN AND LINE DRAIN VALVE. LOCATE 1" NPW AND VALVE 2'-0" ABOVE FINISH FLOOR.
 6. 4" SST FLANGED X MALE QUICK DISCONNECT WITH CAP, OPW, OR EQUAL.
 7. SEE DRAWING 2-C-5 FOR JOINTS.
 8. LOCATION OF CONTROL STATION FOR STORAGE HOPPER DUMP VALVE.



NO.	REVISION	DATE	BY
1	ISSUED PER ADDENDUM #1	6/25/2026	

VERIFY SCALE BAR LENGTH EQUALS ONE INCH ON ORIGINAL DRAWING. VERIFY LENGTH ON THIS SHEET 0' 1' AND ADJUST SCALE ACCORDINGLY.

CITY OF AUSTIN - AUSTIN WATER HORNSBY BEND BIOSOLIDS MANAGEMENT PLANT HEADWORKS	SCREENING FACILITY REFERENCE DRAWING
DESIGN: A. GATHINGS DRAWN: S. MEDINA REVIEW: P. GUNJIUR, P.E. STV: AUST1500124 CLIENT: CIP 3164.075	SHEET M-2A

NO.	ISSUED PER ADDENDUM #1	REVISION	BY	DATE
				6/25/2026

VERIFY SCALE BAR LENGTH EQUALS ONE INCH ON ORIGINAL DRAWING. VERIFY LENGTH ON THIS SHEET IS 1" AND ADJUST SCALE ACCORDINGLY.

0 1"

CITY OF AUSTIN - AUSTIN WATER


SCREENING FACILITY REFERENCE DRAWING

DESIGN:	A.GATHINGS
DRAWN:	S.MEDINA
REVIEW:	P.GUNJUR, P.E.
STV:	AUST1500124
CLIENT:	CIP 3164.075


SHEET
M-2B



PRINTED BY: MedinaSR DATE: 6/25/2026
FILE PATH: C:\pwworking\cpw_cpy\medina\0747958\AUST1500124_05_M-02_COPY.dwg

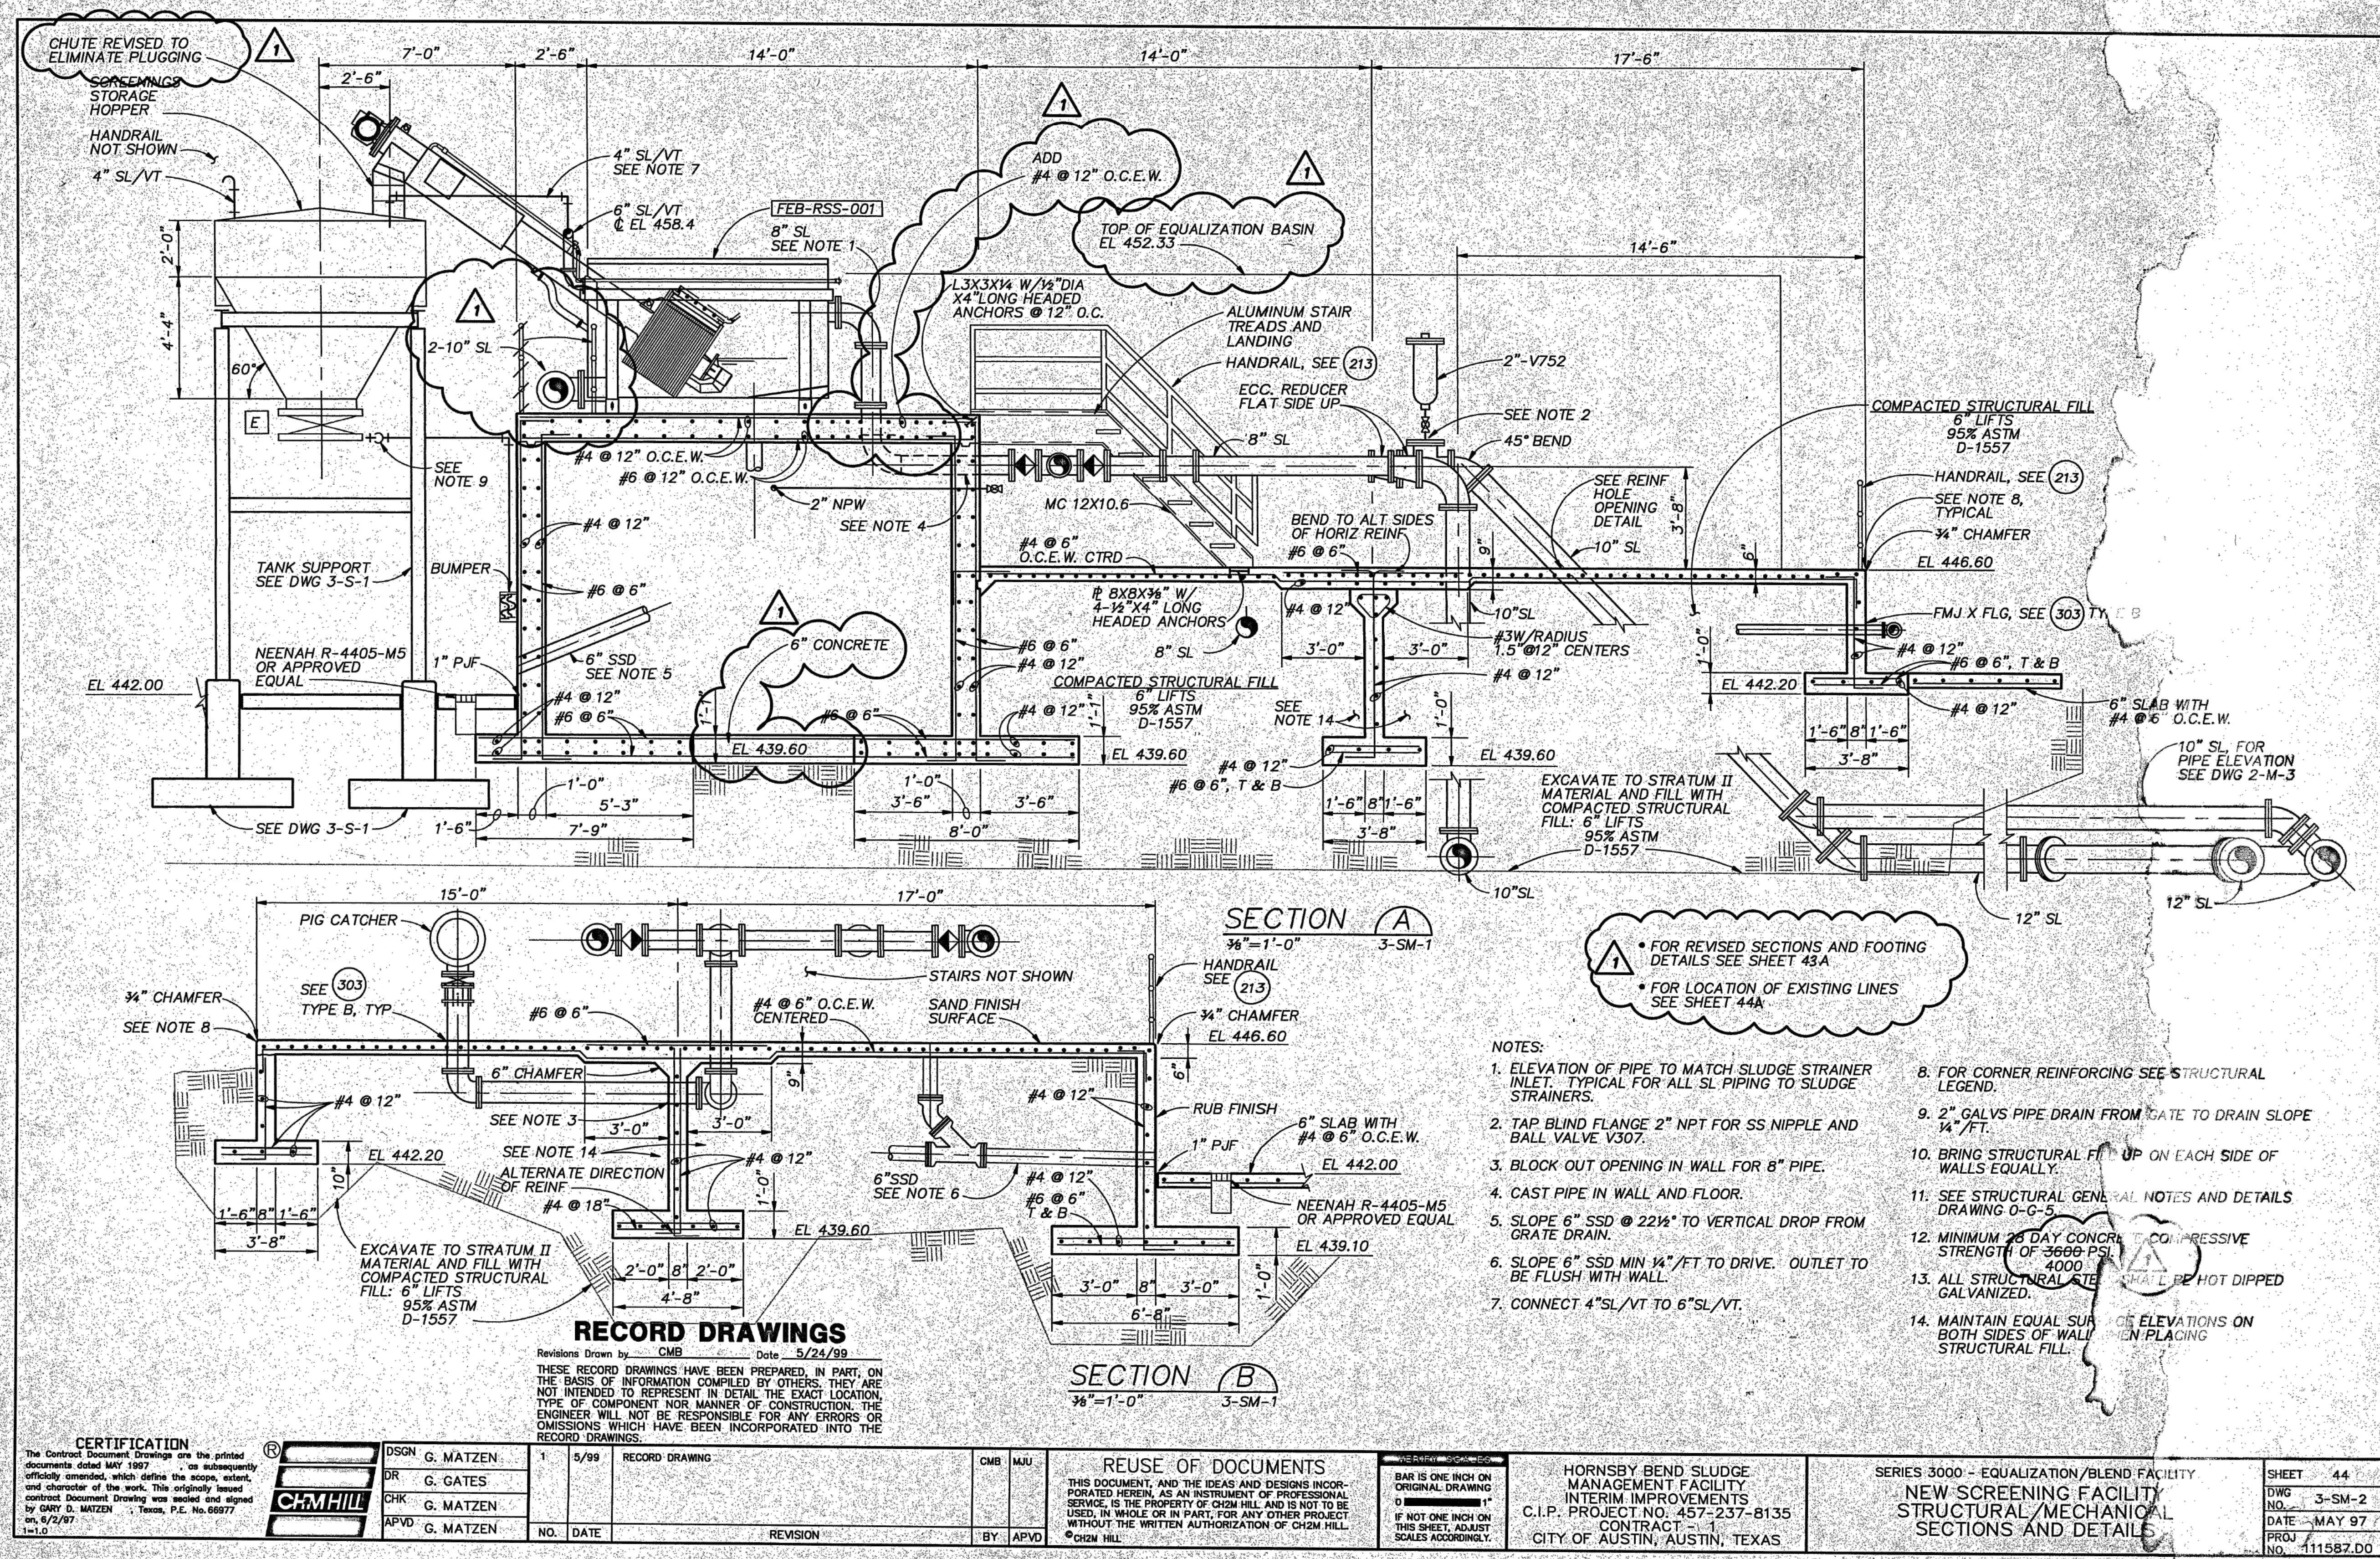

SCREENING FACILITY REFERENCE DRAWING
NTS

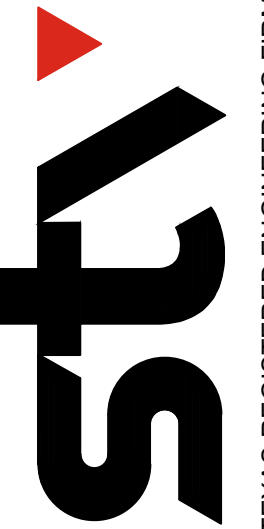

TEXAS REGISTERED ENGINEERING FIRM
F-204



ISSUED PER ADDENDUM #1	DATE	6/25/2026
NO.	BY	
VERIFY SCALE: BAR LENGTH EQUALS ONE INCH ON ORIGINAL DRAWING. VERIFY LENGTH ON THIS SHEET 0' AND ADJUST SCALE ACCORDINGLY.		

CITY OF AUSTIN - AUSTIN WATER
HORNSBY BEND BIOSOLIDS MANAGEMENT PLANT HEADWORKS

SCREENING FACILITY
REFERENCE DRAWING

DESIGN:	A. GATHINGS
DRAWN:	S. MEDINA
REVIEW:	P. GUNJIUR, P.E.
STV:	AUST1500124
CLIENT:	CIP 3164.075

SHEET
M-2C